Radiation Protection Survey Map – Room 509

Performed By: Top Notch Tech Survey Date/Time: less than one week old

Reviewed By: Senior RPT Supervisor Date: Same day as survey

Location Surveyed: General Areas of Room 509 Buffer Zone and RCA

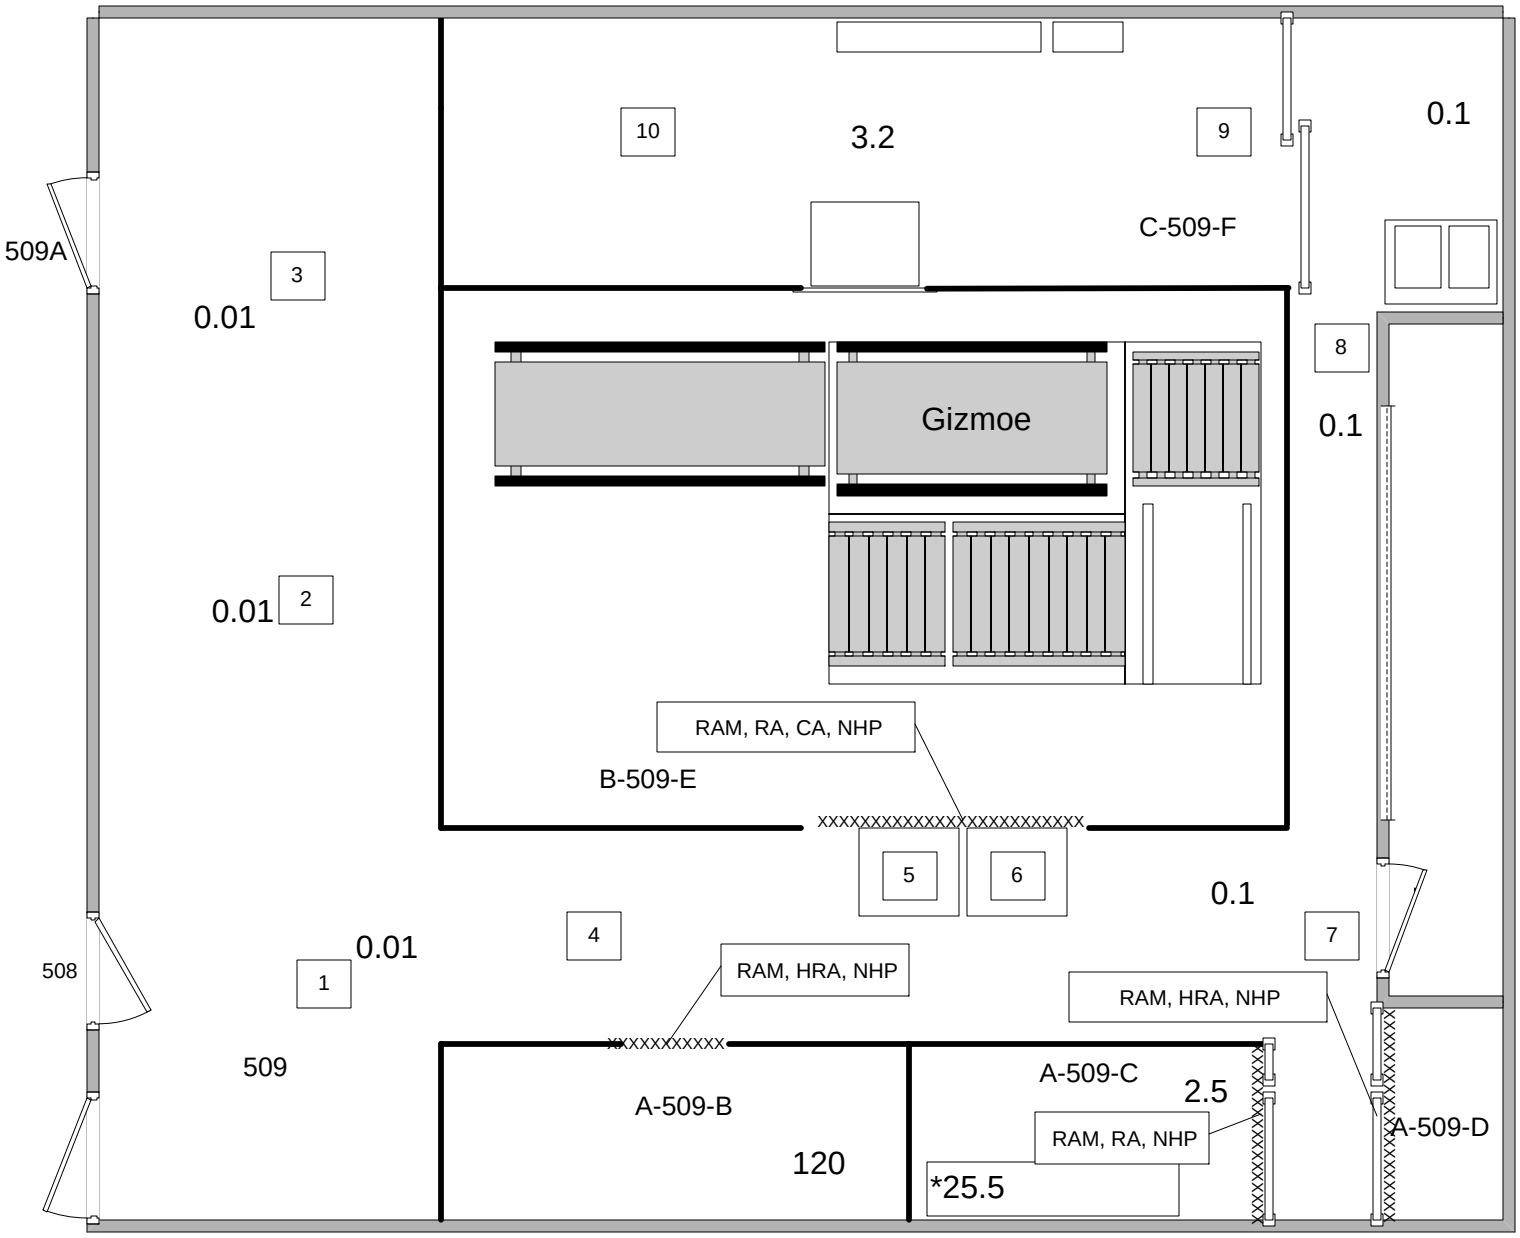

= Swipe Location * = Contact Dose Rate mrem/hr = Air Sample Location LAS = Large Area Swipe

All dose rates in mrem/hr unless otherwise noted

Air Sample
Model: NA
Serial No.: NA
Start LPM: NA
Stop LPM: NA

Contamination Survey Meter
Model: Ludlum Model 12 w/489-110C
Serial No.:CMC009665
Cal Due:1-1-2012

Background: 30 cpm

Radiation Survey Meter
Model: Bicron Micro-R
Serial No.: CMC007845
Cal Due: 1-1-2012
Background: 0.01 mR/hr

Removable Contamination			
Swipe #	Net cpm	dpm/100 cm2	Remarks
	All LAS are <100 ccpm		

Training Only – DOES NOT REPRESENT AN ACTUAL HAZARD